



PLAN

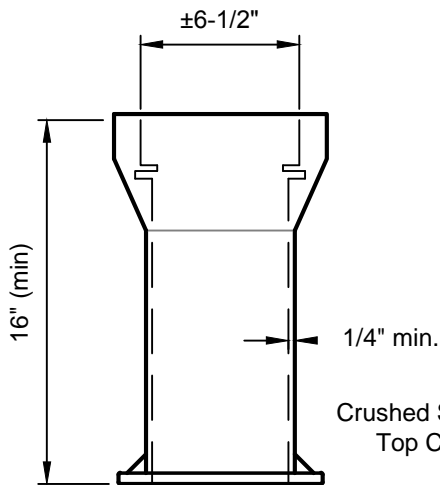

SIDE VIEW

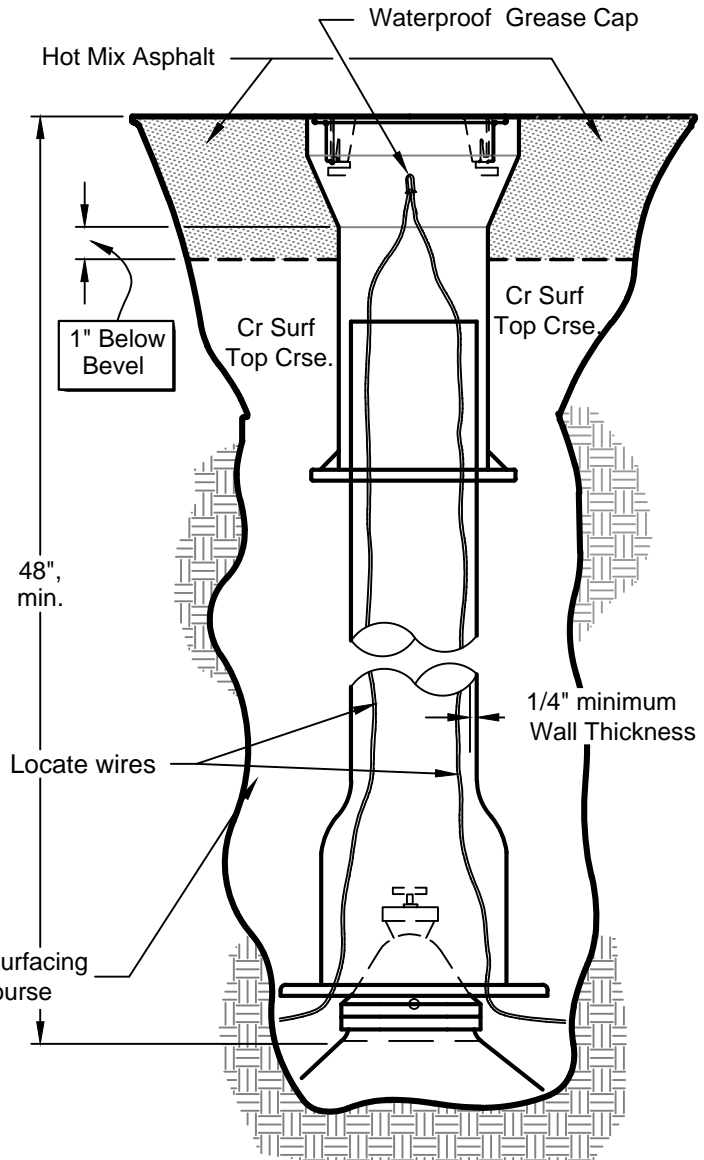

TYPICAL
INSTALLATION

Notes:

1. Valve box and cover shall be ASTM Class 30 grey iron.
2. Use with matching gate valve box extension pipe.
3. See utility cover adjustment, Standard Drawing 23.
Use TYLER ® Series 6855, East Jordan Series 8555, or approved equal.
4. Compact hot mix asphalt patch in no greater than 3-inch lifts.

P:\Engr & CAD\STANDARD DWGS - ALL YEARS\Std Dwgs 2014\Waterline Valve Box & Cover 11.dwg

dwc 3-00
ZGS

VALVE BOX AND COVER

PAGE NO:

11

CITY OF PULLMAN
ENGINEERING DIVISION

ADOPTED: 12-09-2014